


Distributed I/O Module 4 digital inputs + 4 relay outputs communicating over RS-485

DAT 3130

FEATURES

- Modbus Server device on RS-485
- Modbus RTU/ Modbus ASCII protocol
- 4 digital inputs
- 4 relay outputs (2 SPDT + 2 SPST)
- Watch-Dog alarm
- Four ways galvanic isolation 1500 Vac
- CE / UL / UKCA mark
- DIN rail mounting in compliance with EN-50022



GENERAL DESCRIPTION

The device DAT 3130 is able to acquire up to 4 digital inputs and to drive up to 4 relay outputs. The data are transmitted with MODBUS RTU/MODBUS ASCII protocol on the RS-485 network.

To ensure the plant safety, it is provided a Watch-Dog timer alarm.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The device is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market.

It is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 22.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device).

Connect power supply, serial bus, digital inputs and relay outputs as shown in the "Wiring" section.

The "PWR" LED state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

DIGITAL INPUTS		SERIAL OUTPUT	GENERAL SPECIFICATIONS	
Number of Channels	4	Data Transmission (asynchronous serial RS-485) Baud Rate 115.2 Kbps Max. distance 1.2 Km – 4000 ft	Power supply voltage	18 .. 30 Vdc
Input voltage (bipolar)	OFF State : 0÷3 V ON State : 10÷30 V		Reverse polarity protection	60 Vdc max
Input Impedance	4.7 KOhm		Max. Current consumption	120 mA
Sample time	5 ms		ISOLATION Among all the ways 1500 Vac, 50 Hz, 1 min	
DIGITAL OUTPUTS			ENVIRONMENTAL CONDITIONS	
Number of Channels	4		Operative temperature	-10°C .. +60°C
Type of Relay	N.2 Relay SPDT N.2 Relay SPST(N.O.)		UL Operative Temperature	-10°C .. +40°C
Maximum switching power per contact (resistive load)	2 A @ 250 Vac 2 A @ 30 Vdc		Storage temperature	-40°C .. +85°C
Max. voltage	250Vac (50 / 60 Hz) , 30Vdc		Humidity (not condensing)	0 .. 90 %
Dielectric Strength between contacts	1000 Vac, 50 Hz, 1 min.		Maximum Altitude	2000 m slm
Dielectric Strength between coil and contacts	4000 Vac, 50 Hz, 1 min.		Installation	Indoor
			Category of Installation	II
			Pollution Degree	2
			MECHANICAL SPECIFICATIONS	
			Material	Self-extinguish plastic
			IP Code	IP20
			Wiring	wires with diameter 0.8+2.1 mm ² AWG 14-18
			Tightening Torque	0.5 N m
			Mounting	in compliance with DIN rail standard EN-50022
			Weight	about 210 g.
			CERTIFICATIONS	
			EMC (for the Industrial Environments)	
			Immunity	EN 61000-6-2
			Emission	EN 61000-6-4
			UKCA (ref S.I. 2016 N°1091)	
			Immunity	BS EN 61000-6-2
			Emission	BS EN 61000-6-4
			UL	
			US Standard	UL 61010-1
			Canadian Standard	CSA C22.2 No 61010-1
			CCN	NRAQ/NRAQ7
			Typology	Open Type device
			Classification	Industrial Control Equipment
			File Number	E352854

INSTALLATION INSTRUCTIONS


The device is suitable to be mounted on DIN rail, in vertical position. For a correct working and a long life of the device, read the following indications. In case of the devices are mounted side by side, please leave about 5mm between if the temperature in the cabinet higher than 45 °C and high supply voltage (>27Vdc).

Avoid to place raceways or other objects which could obstruct the ventilation slits. It is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Avoid to install the devices in a site where vibrations are present.

It is recommended to use shielded cable for connecting signals. The shield must be connected to an earth wire provided for this purpose. Moreover it is suggested to avoid routing conductors near power signal cables.


CABLING

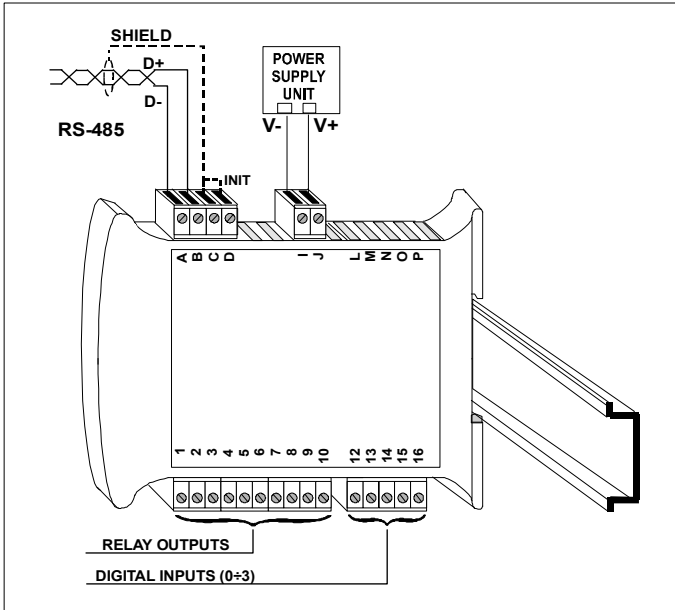


LIGHT SIGNALLING

LED	COLOR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered / Wrong RS-485 cabling.
		FAST BLINKING	Communication in progress (the blinking frequency depends on baud-rate)
		1 second BLINKING	Watch-Dog Alarm condition

ISOLATION STRUCTURE

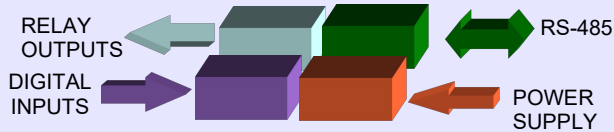


MECHANICAL DIMENSIONS (mm)

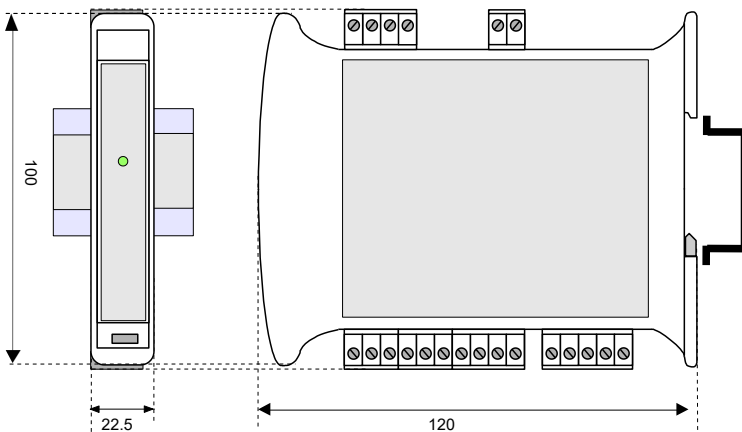


The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.

WIRING

POWER SUPPLY (*)

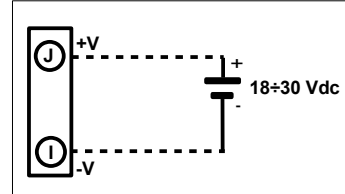


INIT

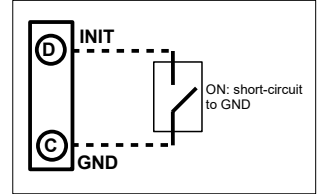


(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV with limited energy

DIGITAL INPUTS

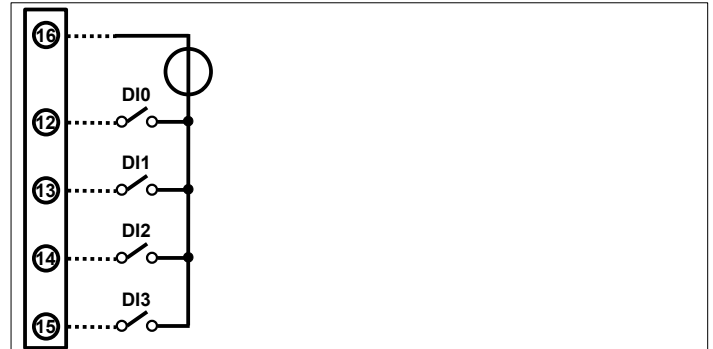


NOTES: Input channels are not insulated between them

RELAY OUTPUTS

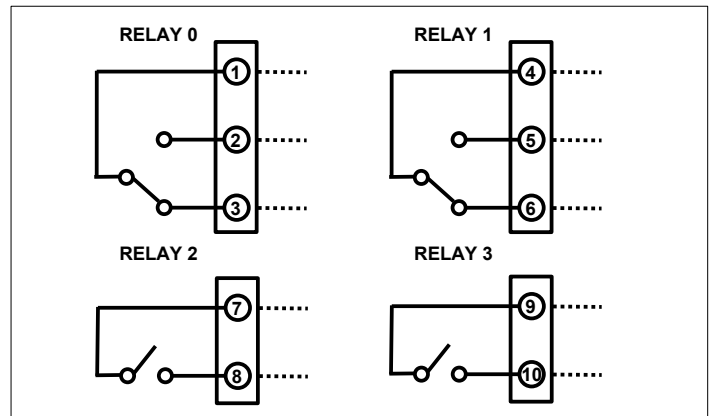

RS-485

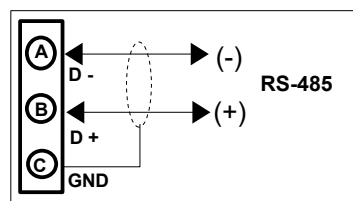

HOW TO ORDER

ORDER CODE:
DAT 3130